


NOTE

The installer must ensure the incoming cold mains has all the required safety devices fitted. A pressure relief valve must be fitted into the domestic hot water circuit. An expansion vessel is optional.

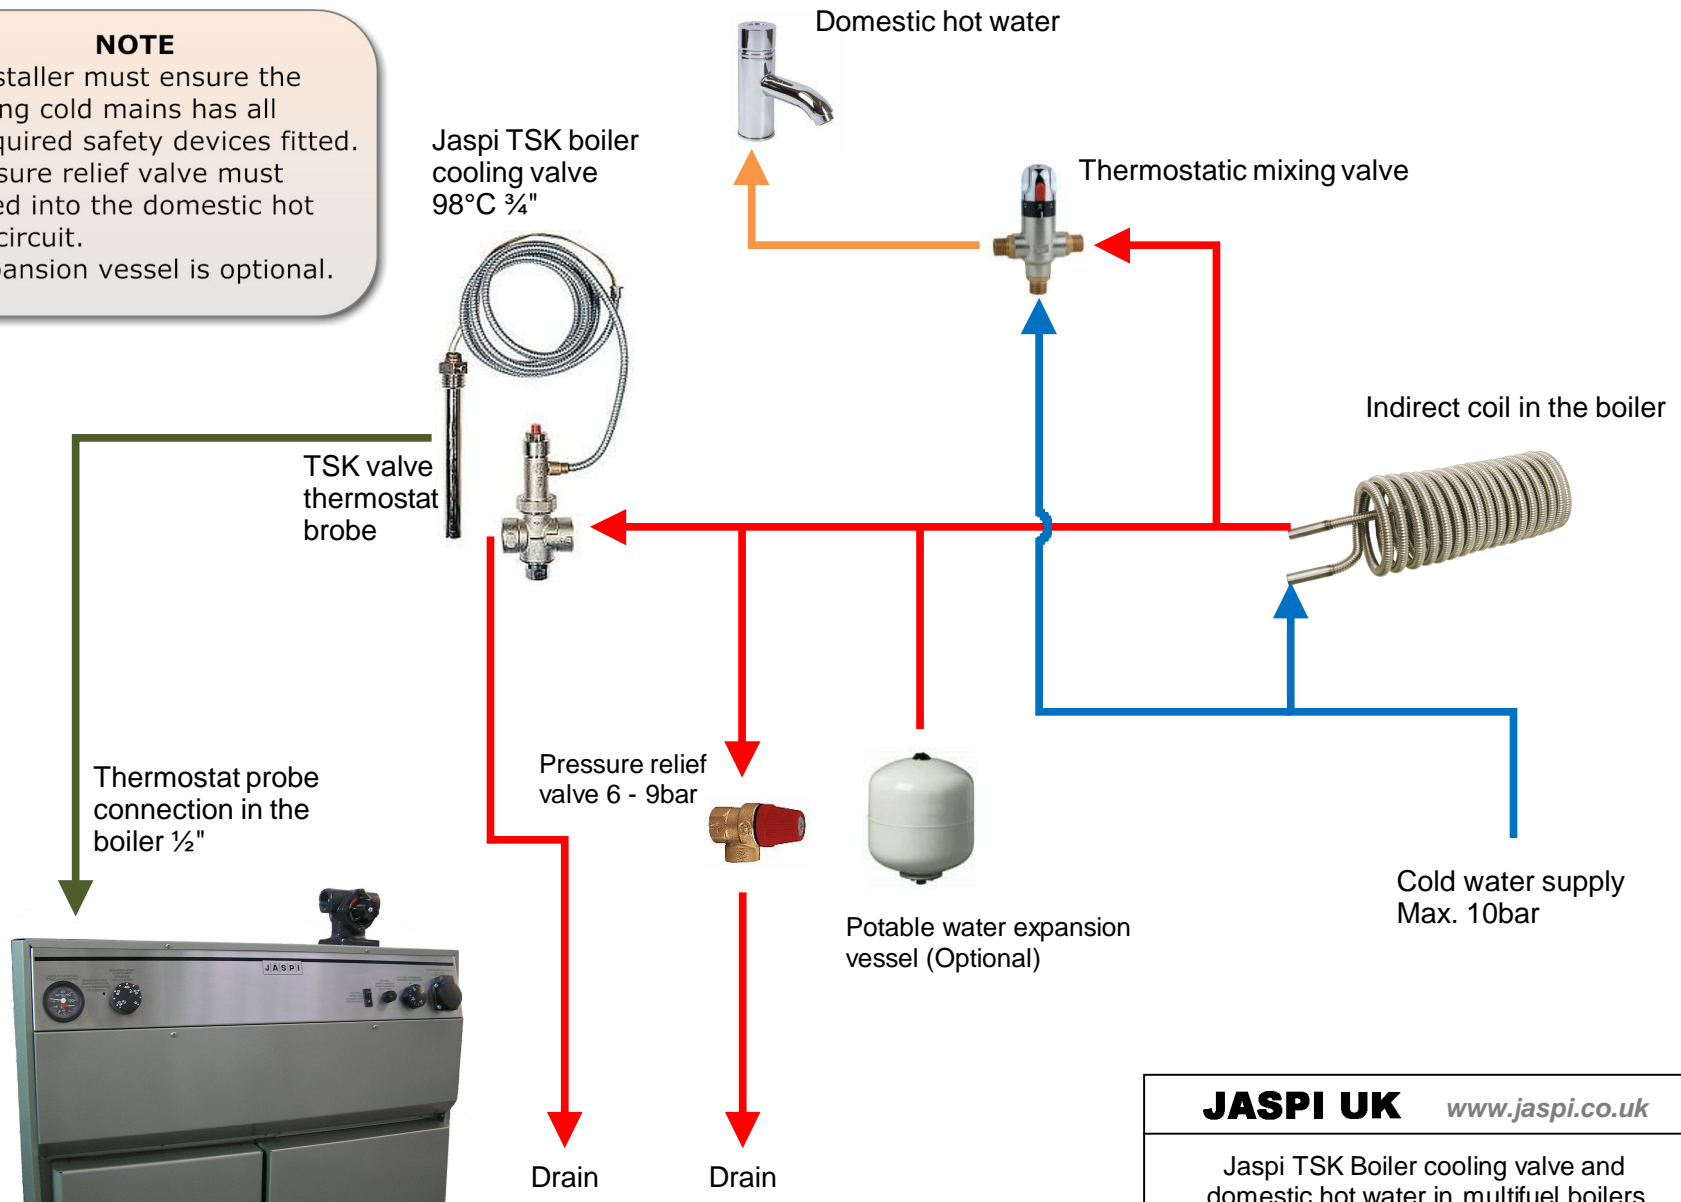

JASPI UK www.jaspi.co.uk			
Jaspi TSK Boiler cooling valve and domestic hot water in multifuel boilers			
Drawn	Version	Date	Drawing Ref
SS		01.06.2011	Generic