


JASPI YPV40 WOOD BOILER & THERMOSTORE 1500K ACCUMULATOR + GAS BOILER + OPEN VENTED DHW

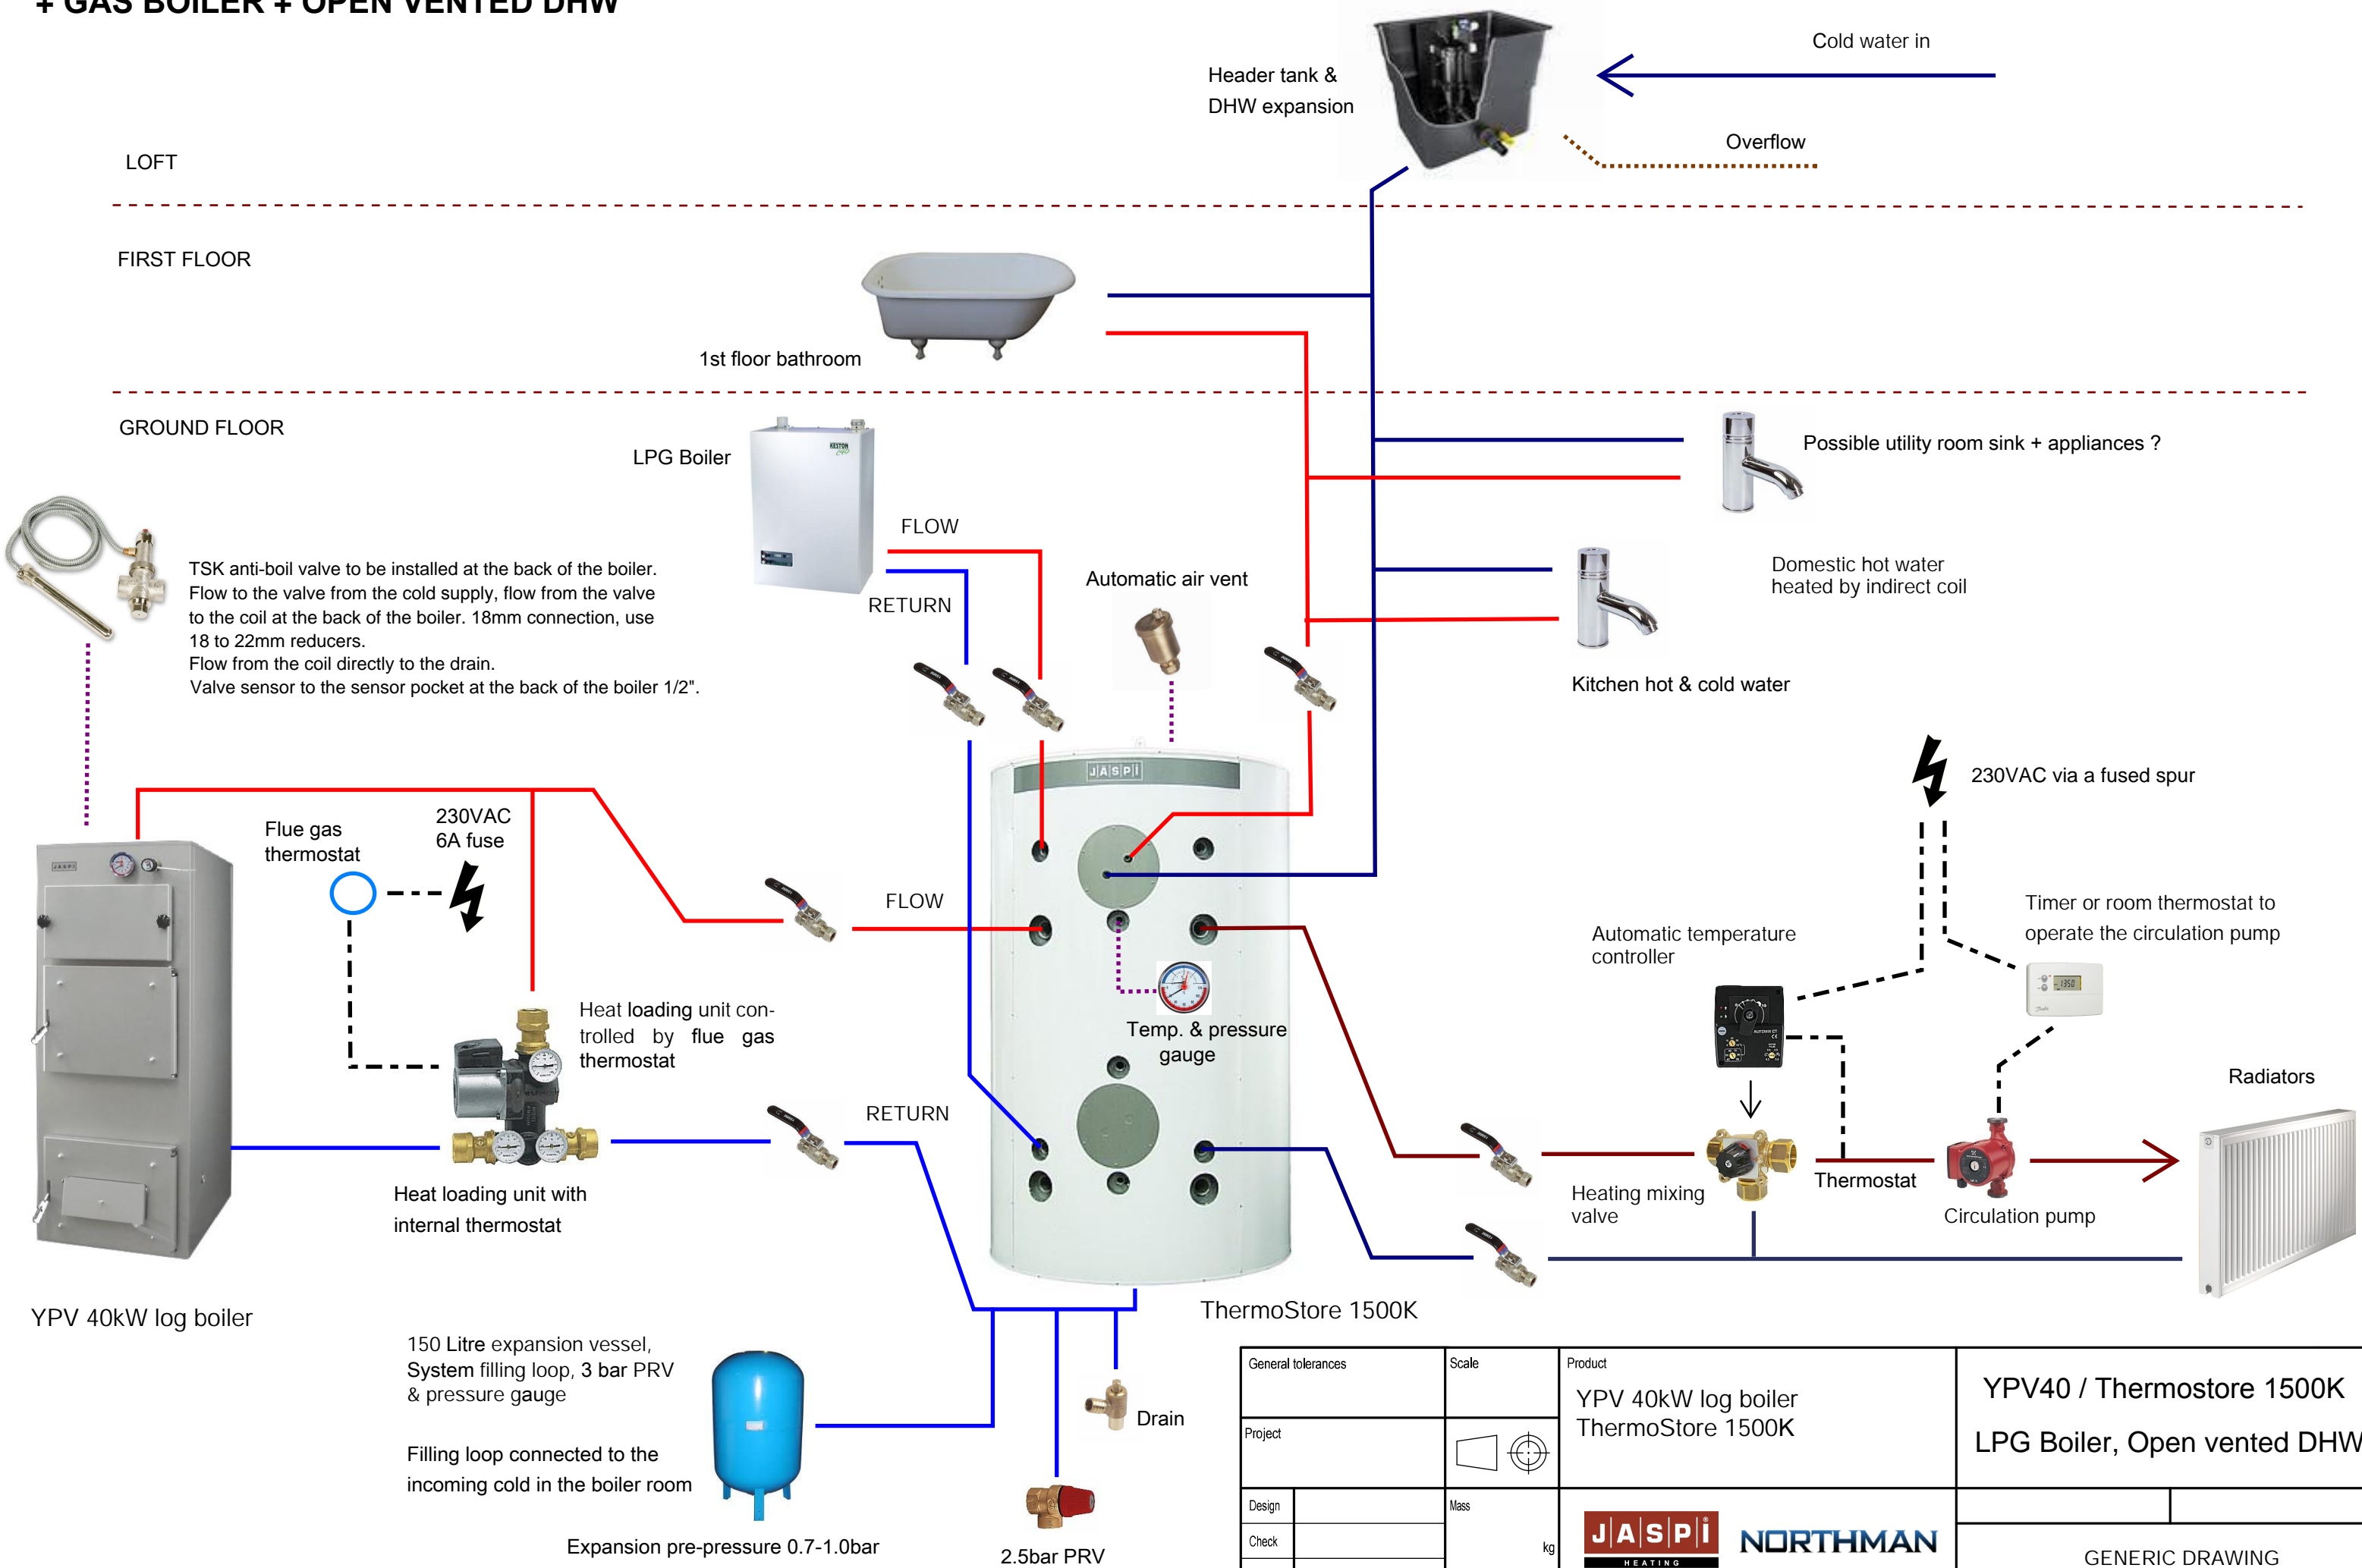

TSK anti-boil valve to be installed at the back of the boiler. Flow to the valve from the cold supply, flow from the valve to the coil at the back of the boiler. 18mm connection, use 18 to 22mm reducers. Flow from the coil directly to the drain. Valve sensor to the sensor pocket at the back of the boiler 1/2".

Flue gas thermostat
 230VAC 6A fuse
 Heat loading unit controlled by flue gas thermostat
 Heat loading unit with internal thermostat

YPV 40kW log boiler

150 Litre expansion vessel, System filling loop, 3 bar PRV & pressure gauge
 Filling loop connected to the incoming cold in the boiler room

Expansion pre-pressure 0.7-1.0bar

2.5bar PRV

General tolerances	Scale	Product	YPV40 / ThermoStore 1500K LPG Boiler, Open vented DHW
Project		YPV 40kW log boiler ThermoStore 1500K	
Design	Mass	NORTHMAN	GENERIC DRAWING
Check	kg		
Acc			